


# BLOCC 3

# BLOCC 2

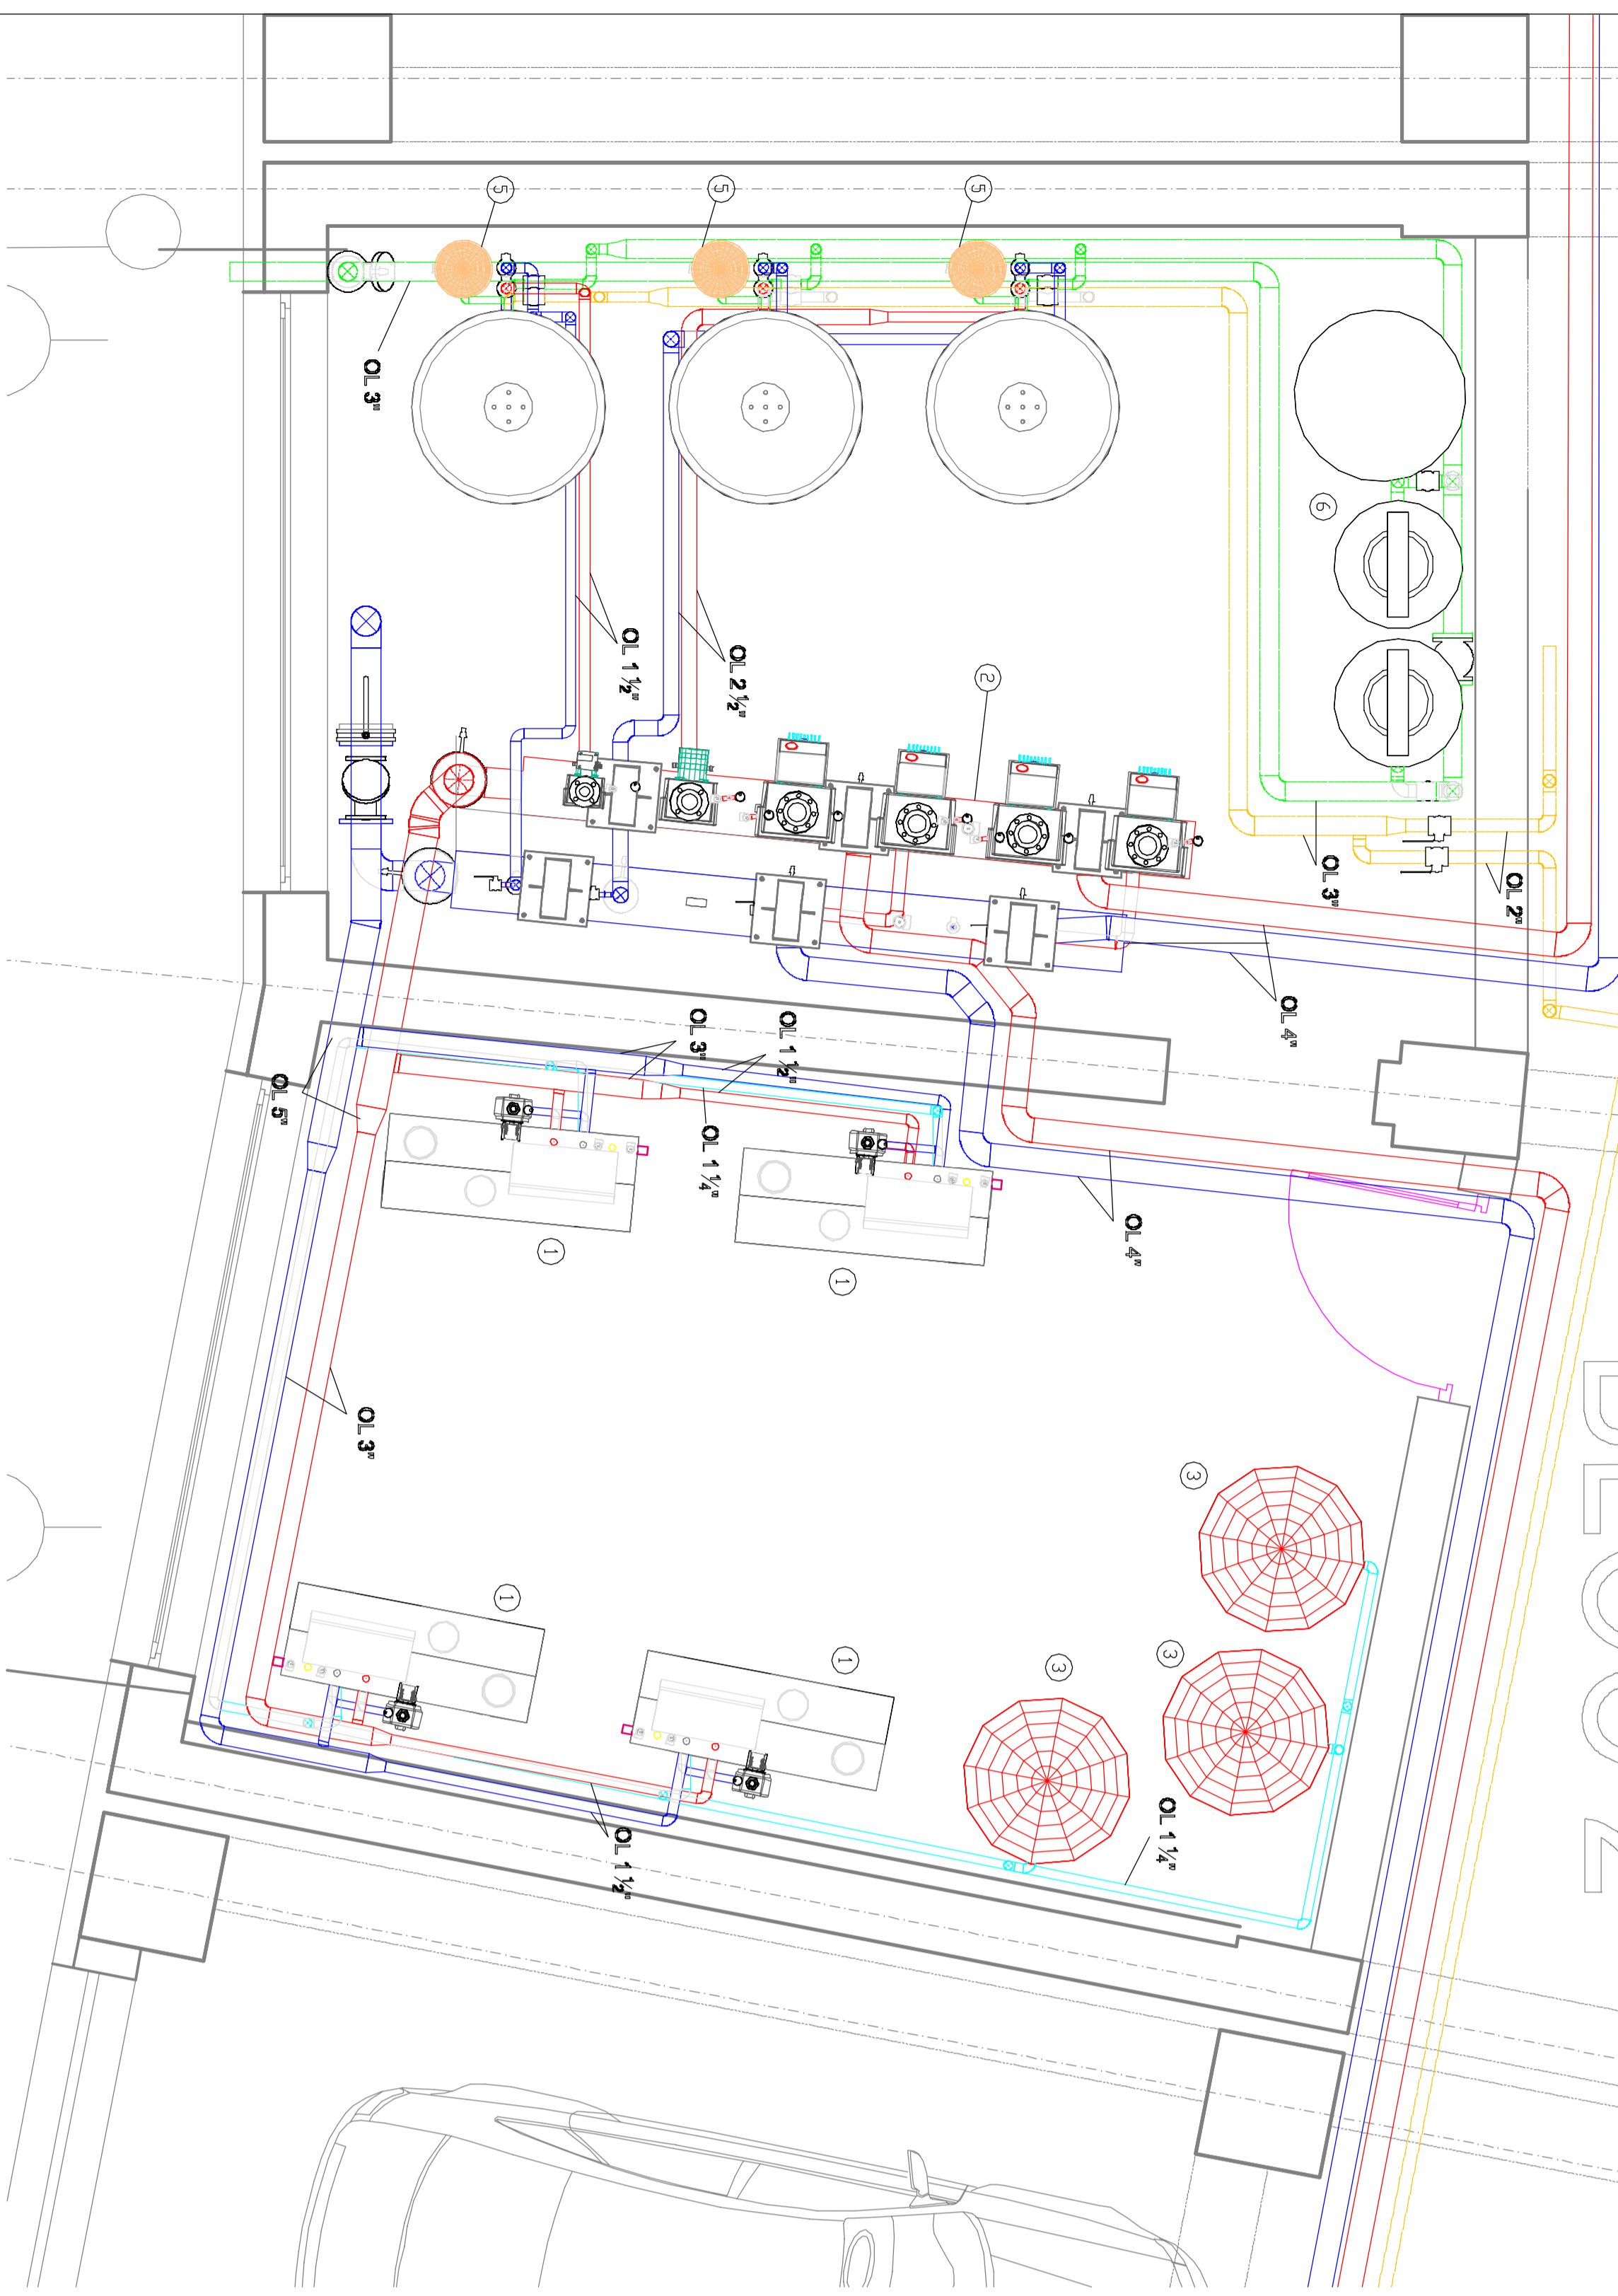

- 1 Cazan cu functionare in condensatie pe gaze;  
Q=217 kW
- 2 Ansamblu distribuitor
- 3 Vas expansiune incalzire; V=500 l
- 4 Boiler 1 ACM; V=1000l; debit 3320 l/h la  $t = 35^{\circ}\text{K}$
- 5 Vas expansiune apa rece-boiler; V=24 l
- 6 Statie de deduzare; 10 mc/h

- Legenda:**
- Conducta DL tur agent termic
  - Conducta DL retur agent termic
  - Conducta DL apa calda menajera
  - Conducta DL apa rece
  - Conducta DL vase expansiune incalzire

